



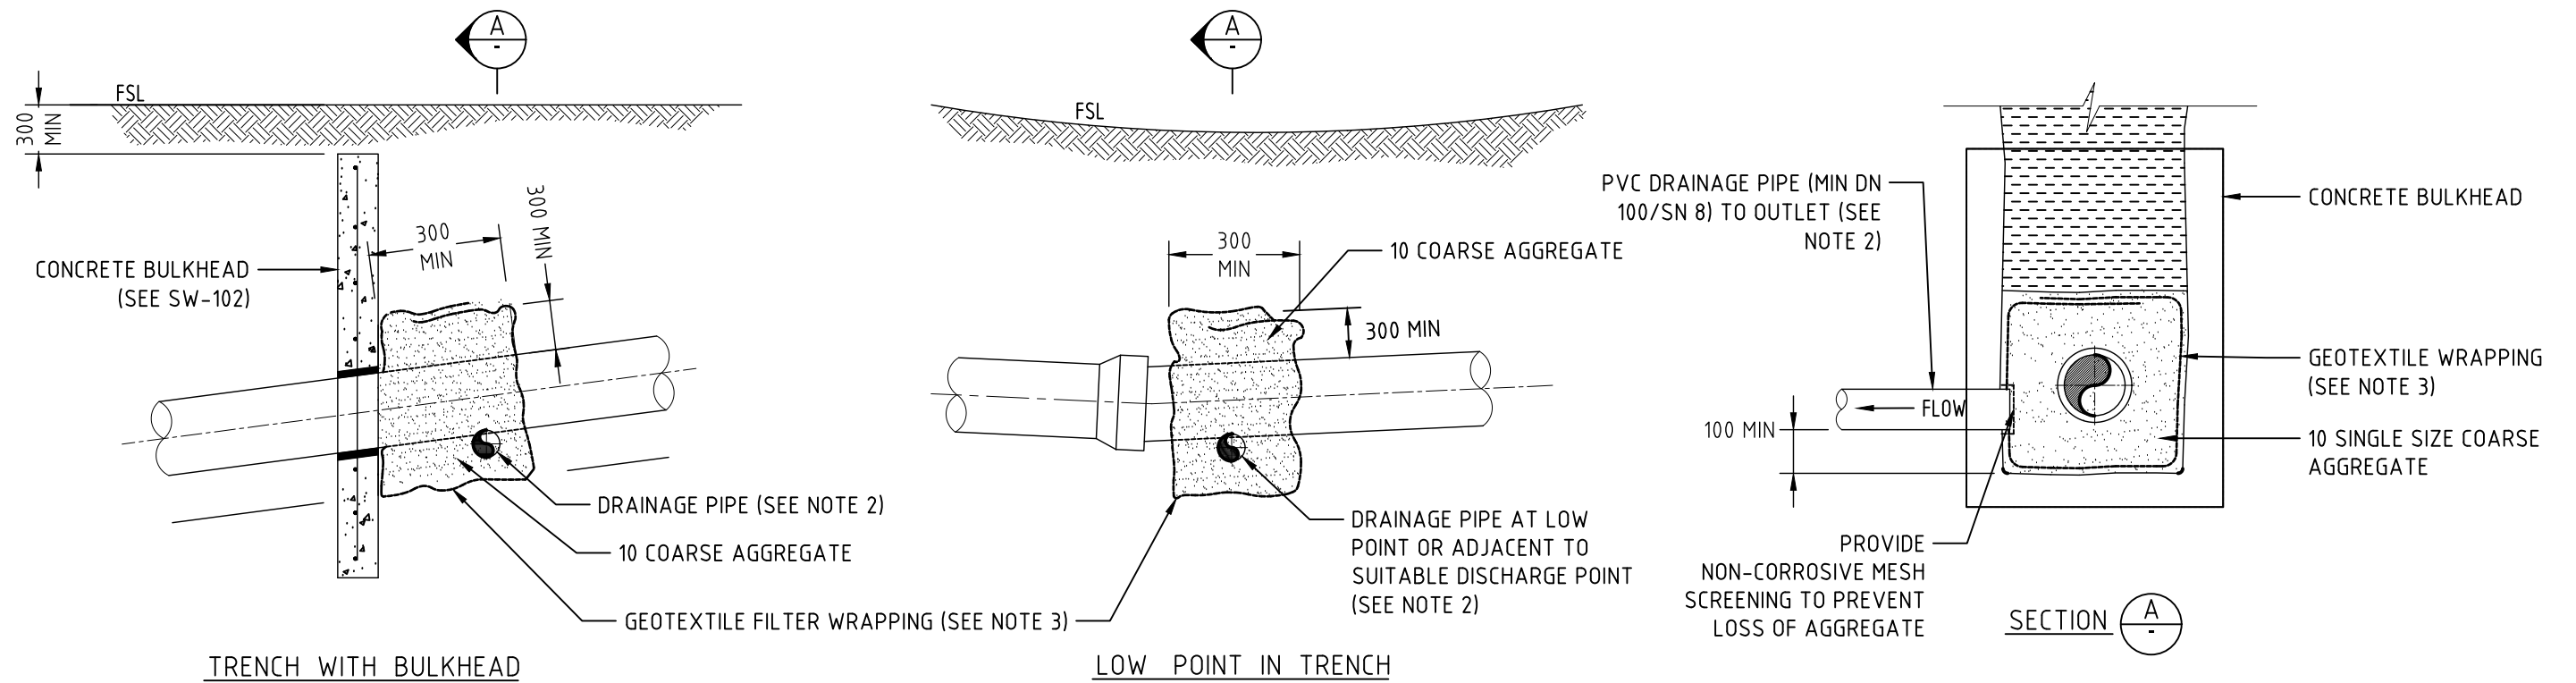

TYPICAL DISCHARGE SYSTEM FOR PIPE TRENCHES

NOTES:

1. ALL DIMENSIONS IN MILLIMETRES.
2. DRAINAGE PIPES TO DISCHARGE INTO AUTHORISED WATER DISCHARGE AREAS (AS SHOWN IN DESIGN DRAWINGS).
3. LAY GEOTEXTILE FILTER FABRIC IN TRENCH SUCH THAT IT FULLY ENCAPSULATES THE DRAINAGE MATERIAL (COARSE AGGREGATE). PROVIDE MINIMUM OF 250 LAP AT ALL FILTER FABRIC JOINTS.
4. PROVIDE CONTINUOUS DRAINAGE PATH:
 - THROUGH BULKHEADS.
 - IN TRENCH EXCAVATIONS ACROSS ROADWAY.
5. WHERE REINFORCING IS USED LOCATE DRAIN INSIDE THE REINFORCING. DEPTH MAY NEED TO BE INCREASED TO COMPENSATE.

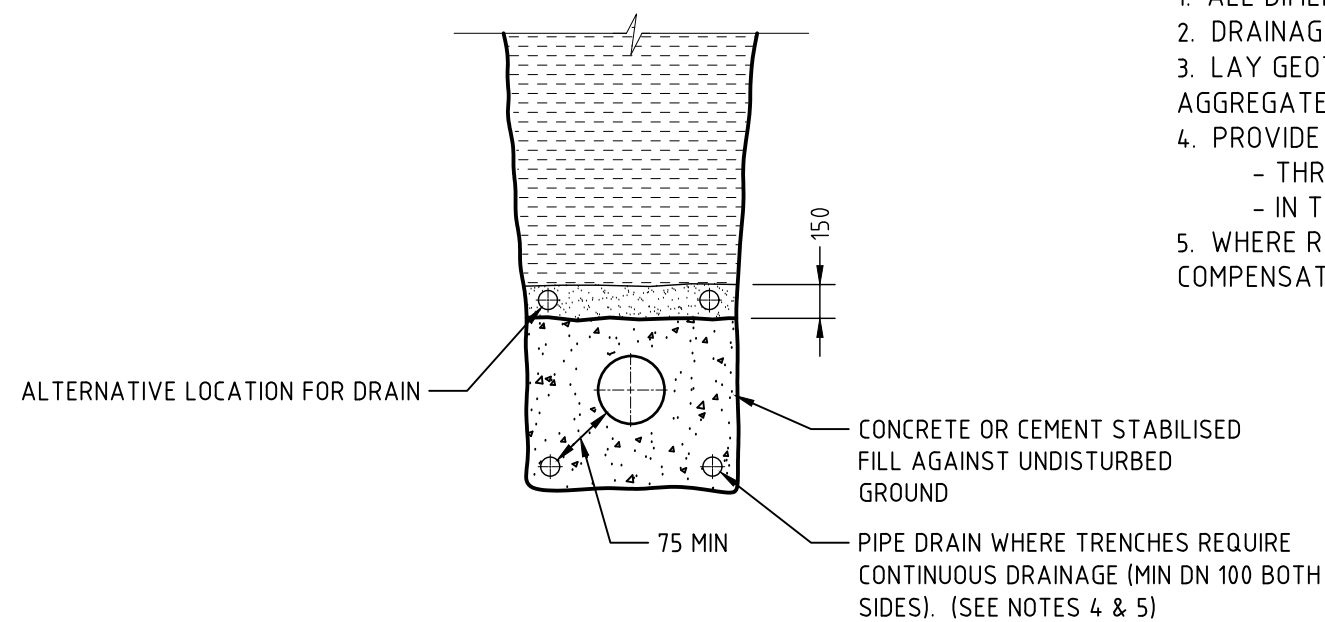

TRENCH DRAINAGE FOR CONCRETE ENCASEMENT/STABILISATION

ACKNOWLEDGEMENT:
PORT STEPHENS COUNCIL ACKNOWLEDGES THE ASSISTANCE OF THE CITY OF NEWCASTLE IN THE DEVELOPMENT OF THIS DRAWING.

SR PCG - STANDARDS REVIEW PROJECT CONTROL GROUP
ASM - ASSET SECTION MANAGER

Date	Amendment	Rev	By	Approved
12.05.26	ISSUED FOR CONSTRUCTION	0	SR PCG	ASM



Project:	STANDARD DETAILS
EDRMS No:	PSC2016-01993-005
Drawing Title:	STORMWATER PIPE CONCRETE BULK HEADS & TRENCH STOPS - SHEET 2 OF 2

APPROVED	Revision: 0
SHEET No:	Date: 12.05.26
SW-103	Sheet Size: A3