

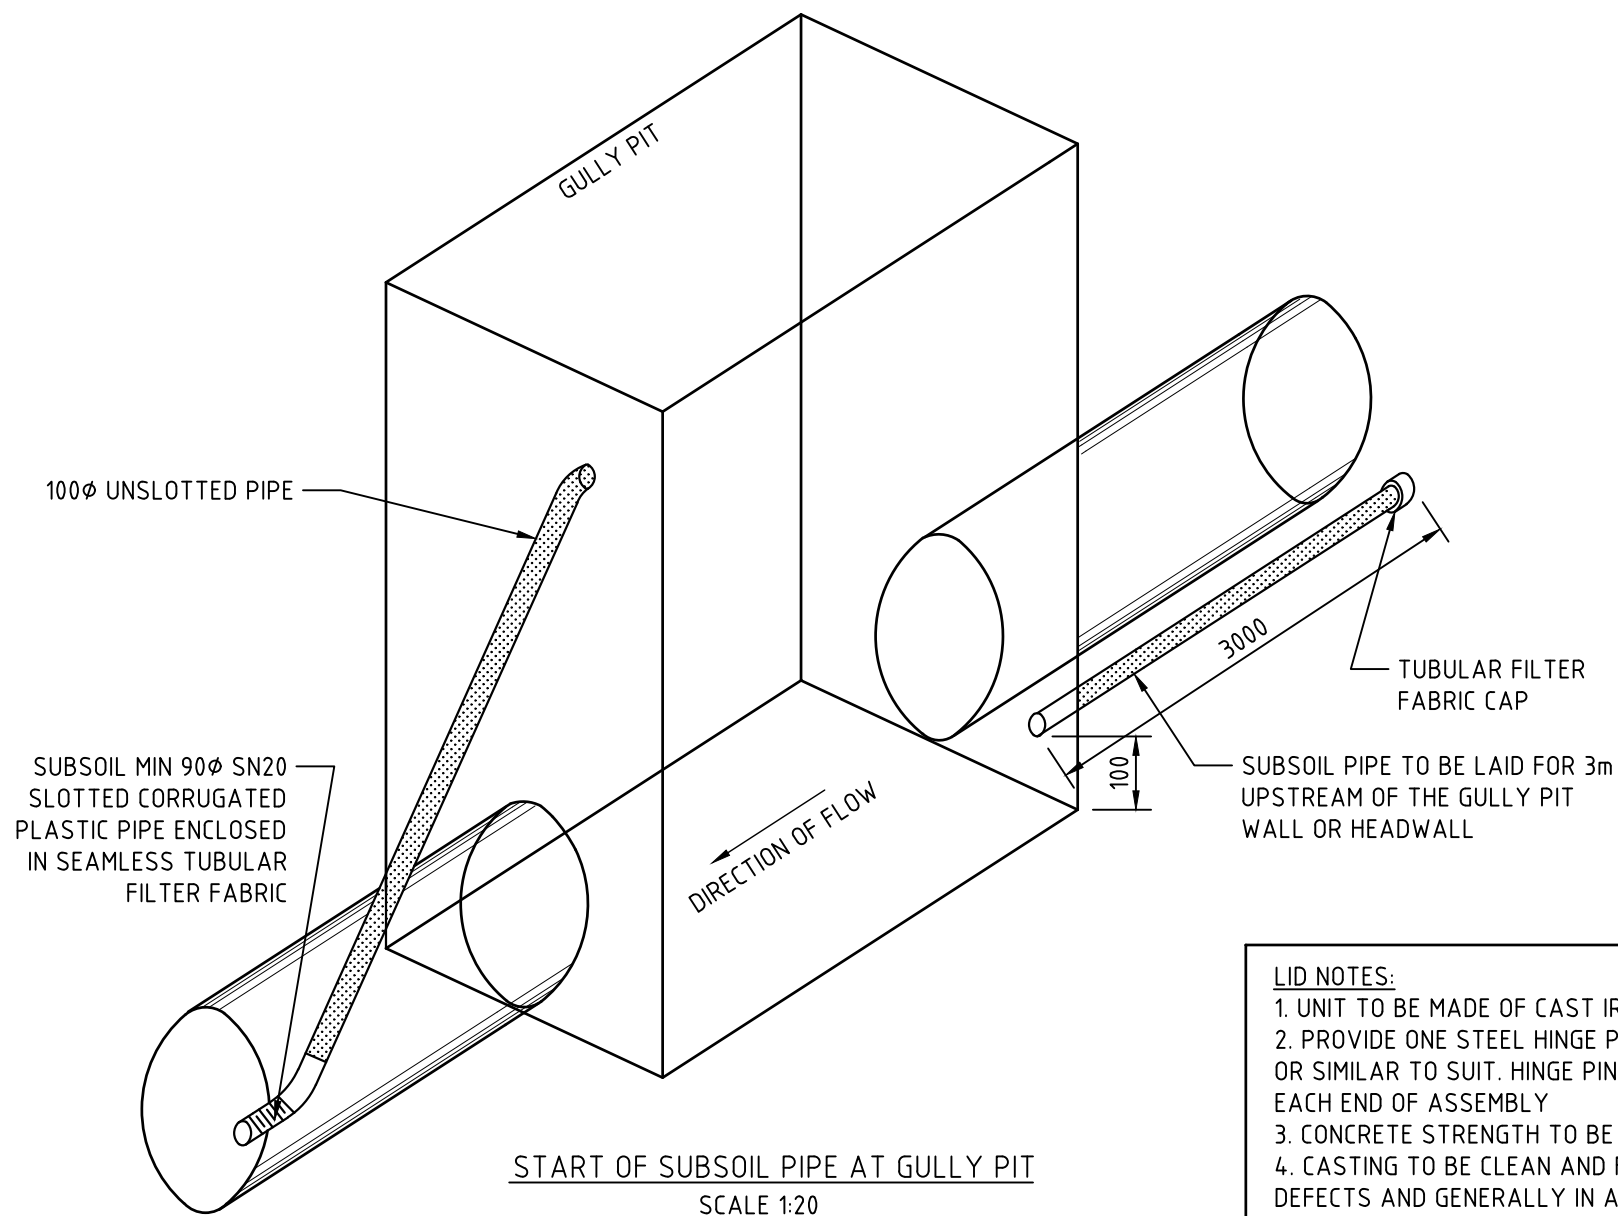
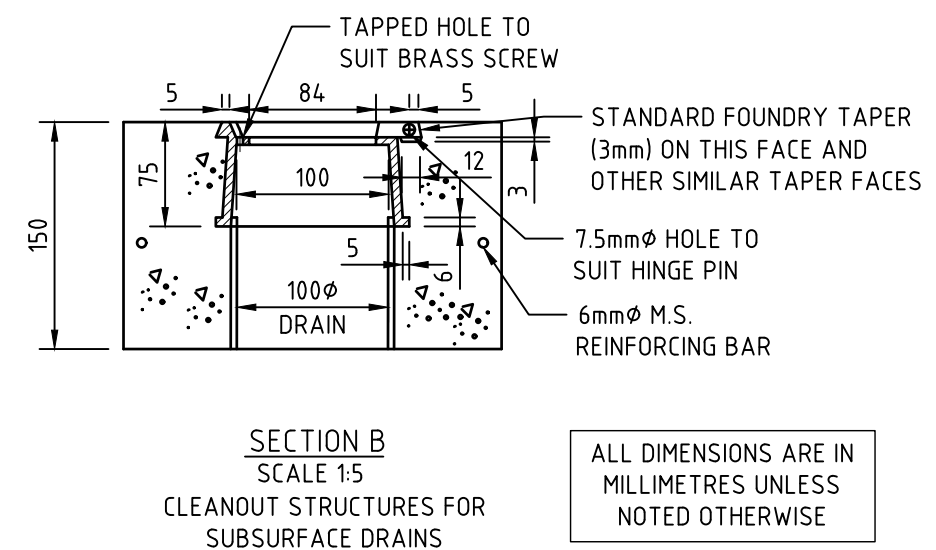
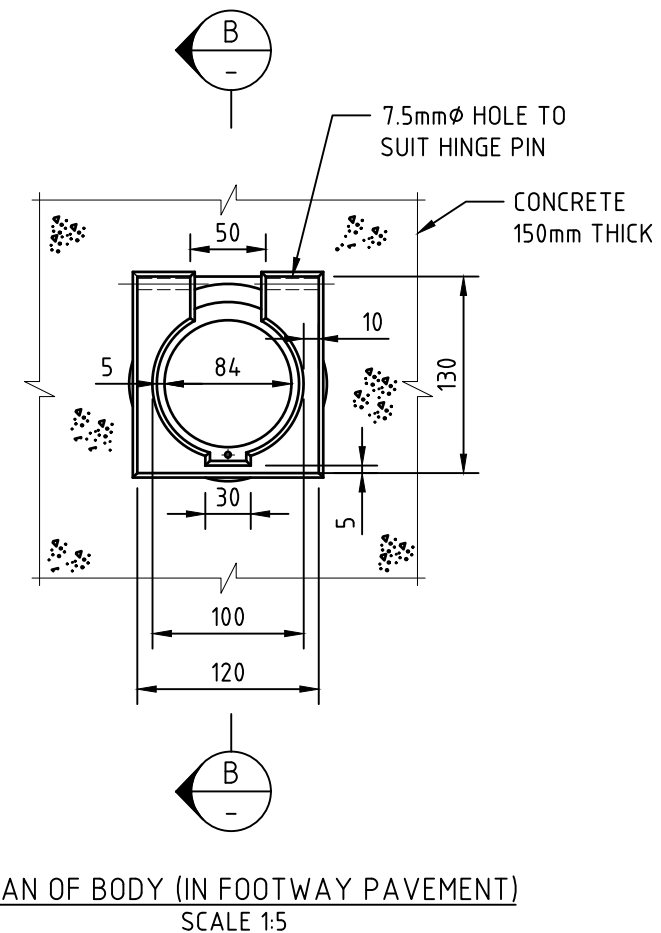


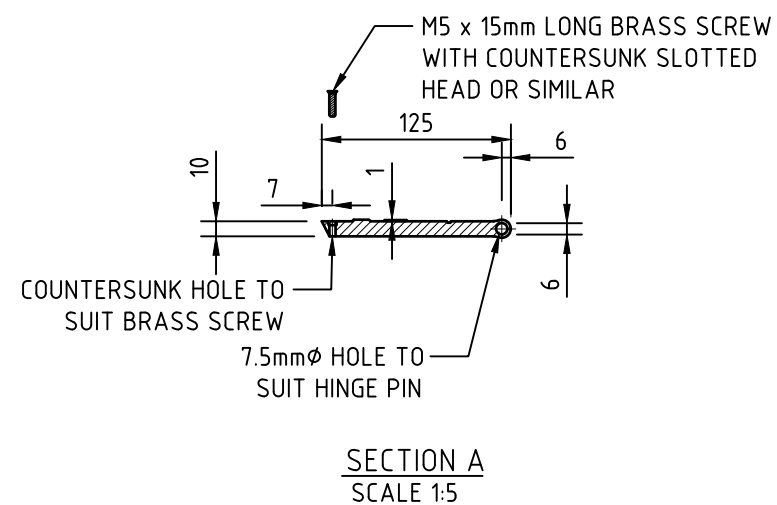

- LID NOTES:**
1. UNIT TO BE MADE OF CAST IRON
 2. PROVIDE ONE STEEL HINGE PIN 150 LONG x 6 THICK OR SIMILAR TO SUIT. HINGE PIN TO BE BENT OVER EACH END OF ASSEMBLY
 3. CONCRETE STRENGTH TO BE 20 Mpa AT 28 DAYS
 4. CASTING TO BE CLEAN AND FREE FROM HARMFUL DEFECTS AND GENERALLY IN ACCORDANCE WITH AS1830.2007

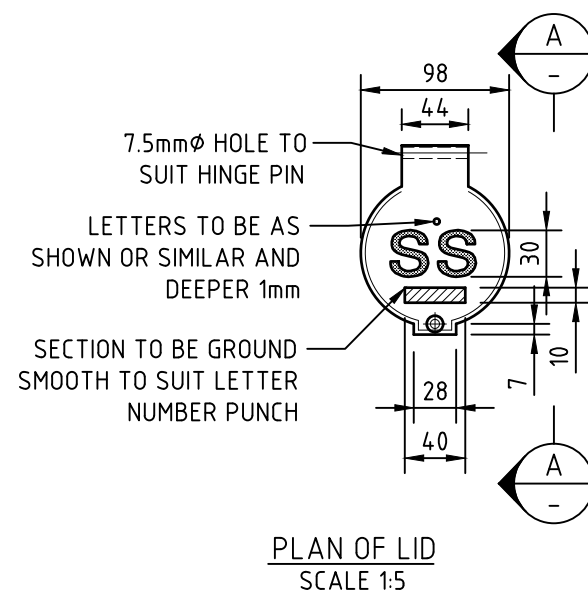

ACKNOWLEDGEMENT:
PORT STEPHENS COUNCIL ACKNOWLEDGES THE ASSISTANCE OF THE CITY OF NEWCASTLE IN THE DEVELOPMENT OF THIS DRAWING.

SR PCG - STANDARDS REVIEW PROJECT CONTROL GROUP
ASM - ASSET SECTION MANAGER

Date	Amendment	Rev	By	Approved
12.05.26	ISSUED FOR CONSTRUCTION	0	SR PCG	ASM



Project:	STANDARD DETAILS
EDRMS No:	PSC2016-01993-005
Drawing Title:	STORMWATER SUBSOIL DRAINAGE FOR ROAD PAVEMENTS - SHEET 2 OF 2

APPROVED	Revision: 0
SHEET No:	Date: 12.05.26
SW-105	Sheet Size: A3